
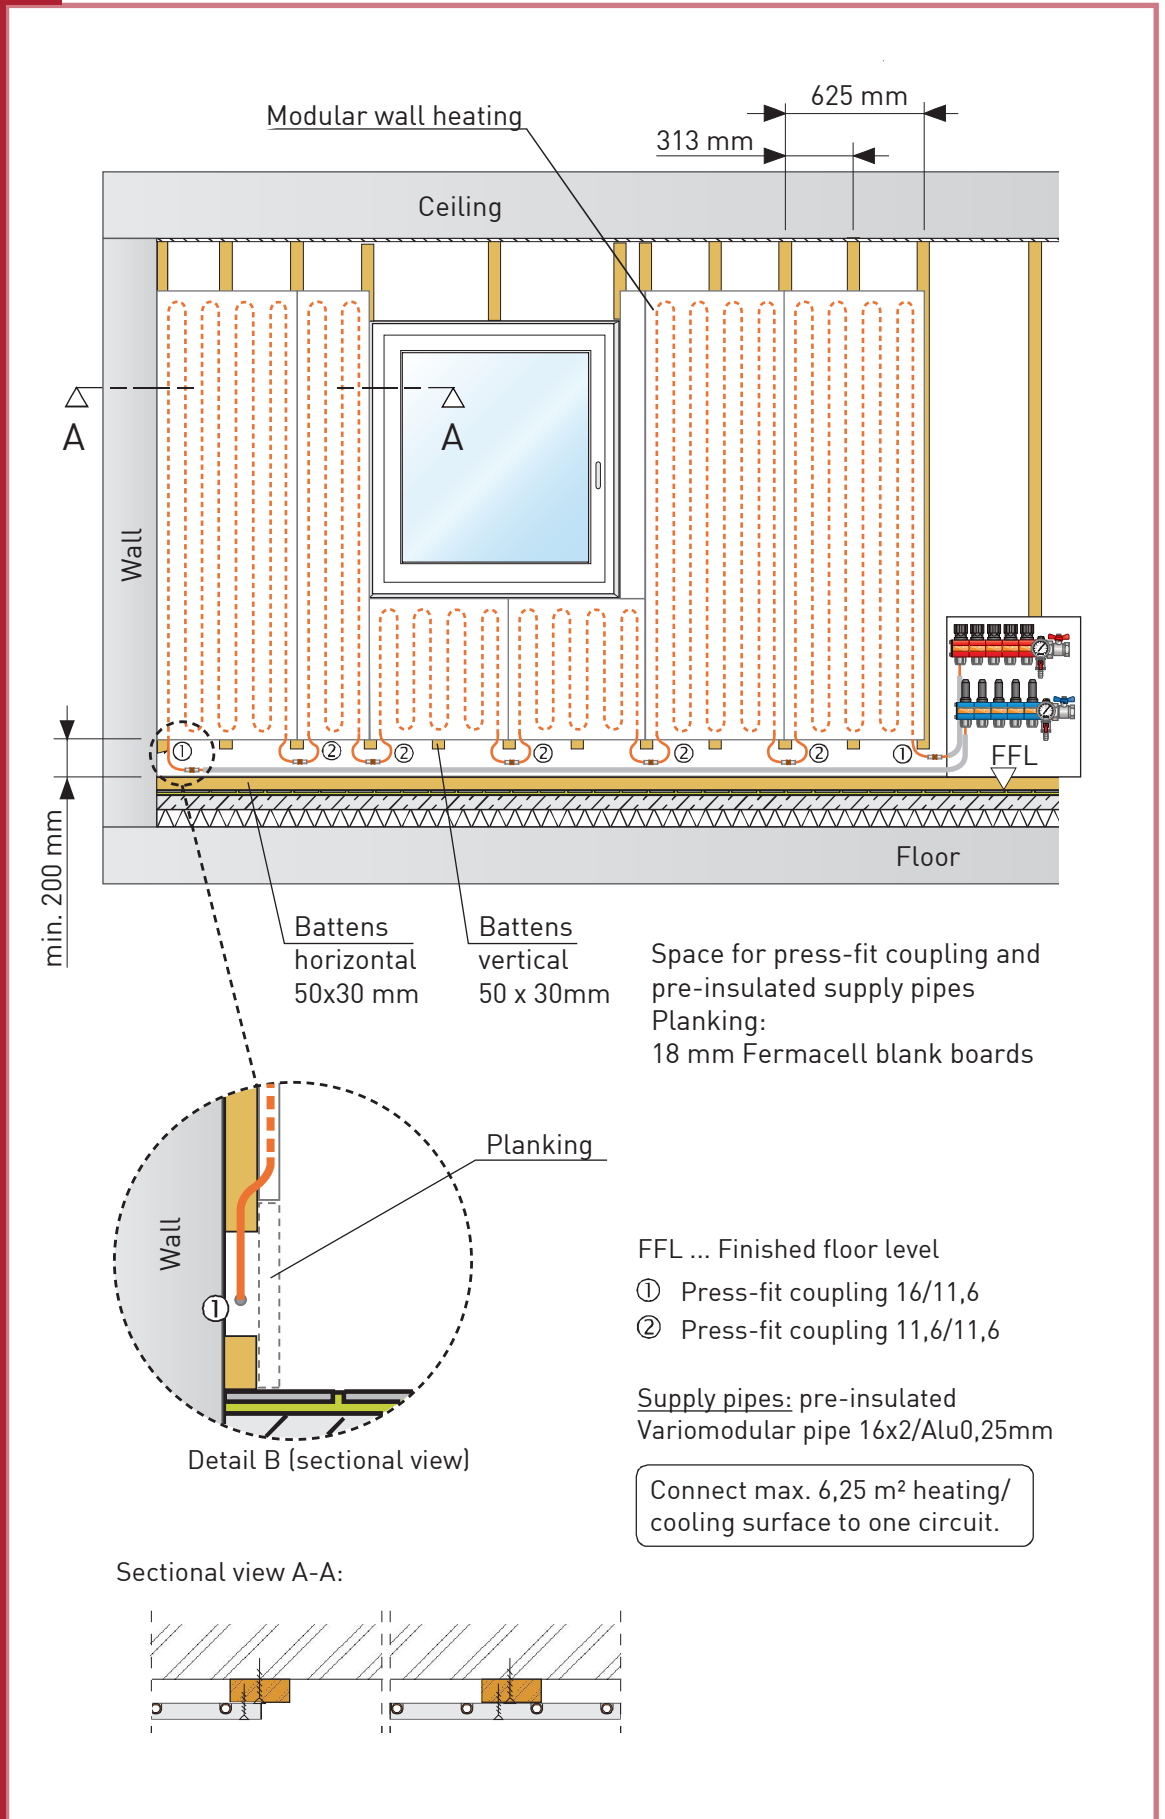


Mounting the modular wall heating/cooling

Substructure variant for existing floors

If the Modular wall heating/cooling is retrofitted, we recommend laying the supply pipes in the batten layer.

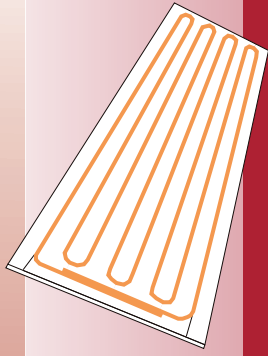

VARIOTHERM
HEATING. COOLING. COMFORT.